




## STANDARD DRIVEWAY DITCH CROSSING

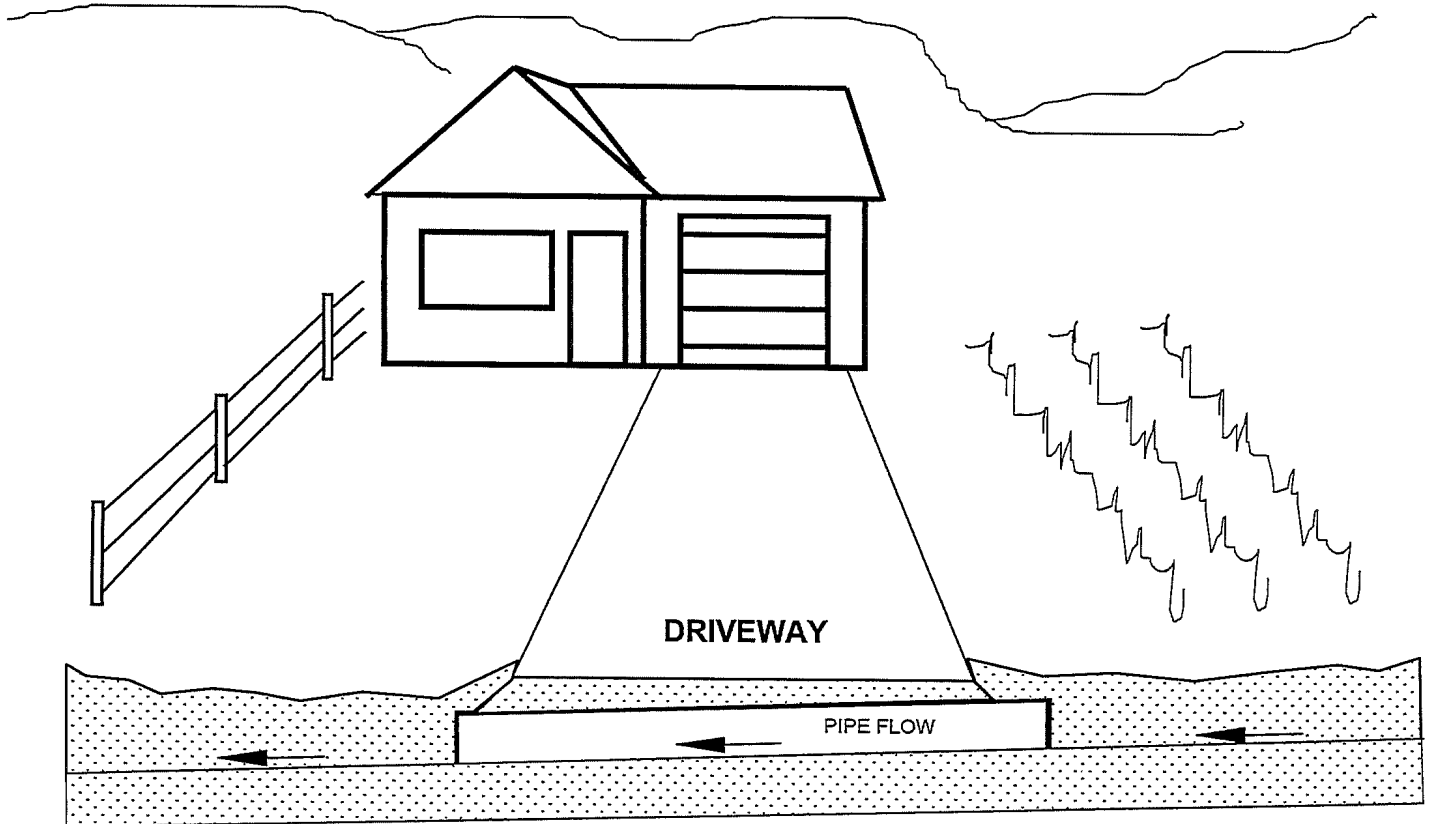

1. Pipe must be not less than 12 inches inside diameter with a minimum length of 20 ft. and be of either reinforced concrete, corrugated metal or high density smooth interior corrugated polyethylene pipe (no substitutes).
2. Pipe shall be placed so that inside flow line of pipe is at bottom of ditch and sloped true to ditch grade, maintaining free and unobstructed flow.
3. Highway shoulder must not be altered.
4. Any rise in driveway shall occur on the backslope of ditch line so that drainage from driveway will flow into the ditch and not into the highway.

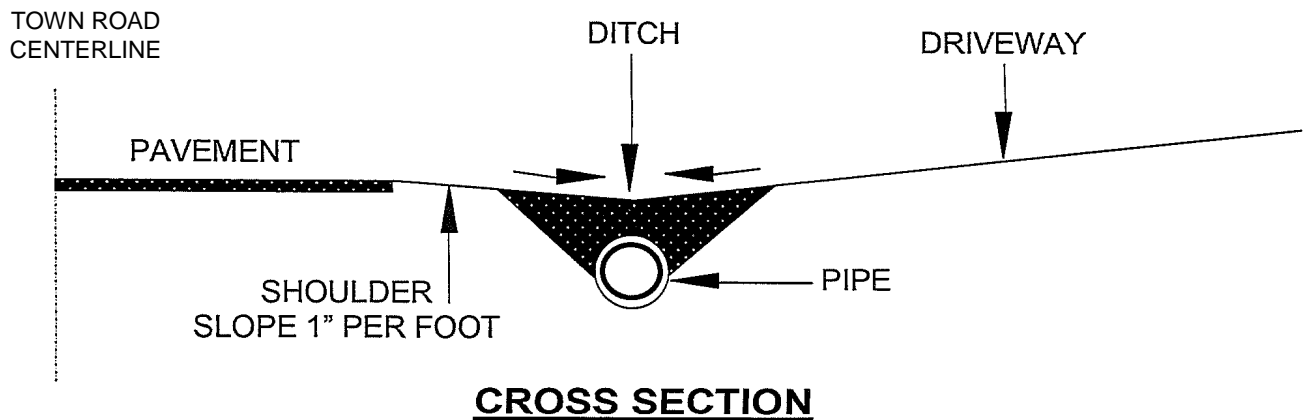

## TYPICAL RESIDENTIAL DRIVEWAY

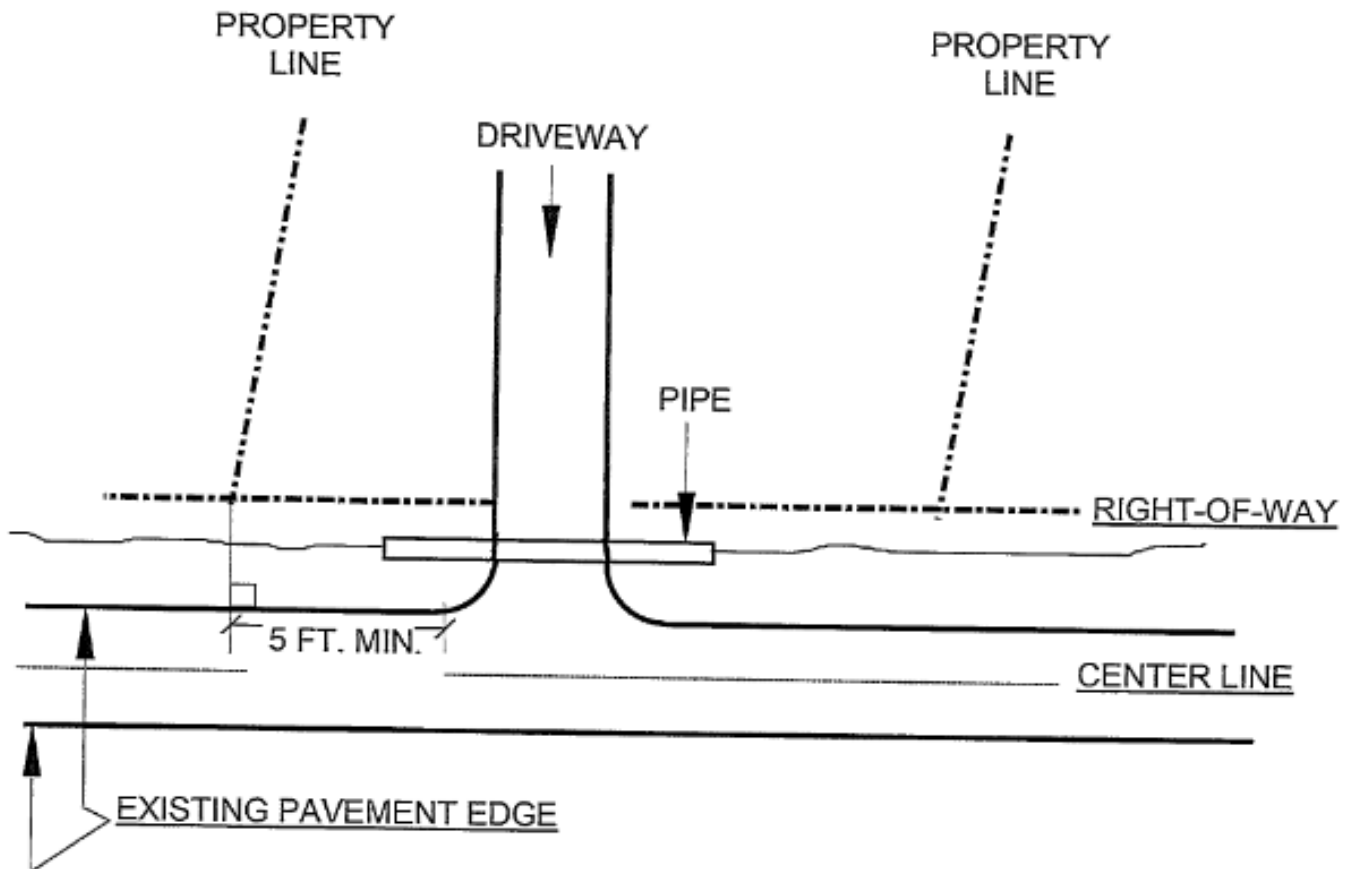

**NOTE:**

1. Residential driveway entrance maximum of 20' wide.
2. Minimum of 5 feet between property line and starting radius of driveway.
3. A sketch of the proposed driveway shall be submitted with each permit application.
4. See Standard Driveway Ditch Crossing Diagram attached.